

## Installation and Operating instructions for **CP70xx Control Panel**

Version: 1.6  
Date: 2007-10-22

**BECKHOFF**

# Table of contents

<b>1. General Notes</b>	<b>2</b>
Notes on the documentation	2
Liability Conditions	2
Description of safety symbols	2
Basic safety measures	3
Operator's obligation to exercise diligence	4
Operator requirements	4
<b>2. Product Description</b>	<b>5</b>
Appropriate Use	5
Connections	5
Pin assignment	5
Connector description	5
CP-Link connection	5
Protective Earthing	5
CP-Link cable sets	6
<b>3. Installation Instructions</b>	<b>7</b>
Transport and Unpacking	7
Transport	7
Unpacking	7
Assembly	8
Assembly dimensions	8
Connecting the Control Panel	9
Connecting cables	9
Protective Earthing	9
<b>4. Operating Instructions</b>	<b>10</b>
Functional description	10
Keyboard codes	10
Servicing and maintenance	12
Cleaning the Control Panel	12
Servicing	12
Replacing the fluorescent lamps in the display	12
Lamp sets	13
Emergency procedures	13
Shutting down	13
Disposal	13
<b>5. Troubleshooting</b>	<b>14</b>
Fault correction	14
Service and Support	15
Beckhoff's branch offices and representatives	15
Beckhoff headquarters	15
Beckhoff Support	15
Beckhoff Service	15
<b>6. Appendix</b>	<b>16</b>
Technical data	16
Approvals	16
FCC: Federal Communications Commission Radio Frequency Interference Statement	16
FCC: Canadian Notice	16

# General Notes

## Notes on the documentation

This description is only intended for the use of trained specialists in control and automation engineering who are familiar with the applicable national standards. It is essential that the following notes and explanations are followed when installing and commissioning these components.

## Liability Conditions

The responsible staff must ensure that the application or use of the products described satisfy all the requirements for safety, including all the relevant laws, regulations, guidelines and standards.

The documentation has been prepared with care. The products described are, however, constantly under development. For this reason, the documentation may not always have been fully checked for consistency with the performance data, standards or other characteristics described. None of the statements in this manual represent a guarantee for as set out in § 443 of the German Civil Code or a statement about the assumed use according to the contract as set out in § 434 para. 1 clause 1 no. 1 of the German Civil Code. In the event that it contains technical or editorial errors, we retain the right to make alterations at any time and without warning. No claims for the modification of products that have already been supplied may be made on the basis of the data, diagrams and descriptions in this documentation.

© This documentation is protected by copyright. Any reproduction or third party use of this publication, whether in whole or in part, without the written permission of Beckhoff Automation GmbH, is forbidden.

## Description of safety symbols

The following safety symbols are used in this operating manual. They are intended to alert the reader to the associated safety instructions.



This symbol is intended to highlight risks for the life or health of personnel.



This symbol is intended to highlight risks for equipment, materials or the environment.



This symbol indicates information that contributes to better understanding.

## Basic safety measures



**Warning**

**Before opening the control panel housing, and whenever the control panel is not being used for control purposes (such as during functional checks after a repair), all parts of the equipment must first be switched off, after which the control panel is to be disconnected from the equipment.**

Disconnect the device by unplugging the connectors on the Control Panel side.

**Items of equipment that have been switched off must be secured against being switched on again.**



**Danger**

Displays used for the control panel's LC-display are operated with a voltage of up to 1000 V, depending on type. For that reason:

**The supply voltage must be disconnected before the housing of the Control Panel is opened.**



**Note**

Assembly work on the Control Panel during operation may damage the panel:

- if metal objects such as screws or tools fall onto operating circuit boards.
- if connecting cables internal to the control panel are removed or inserted during operation

## Operator's obligation to exercise diligence

The operator must ensure that

- the Control Panel is only used for its intended purpose (see [Product Description](#) section);
- the Control Panel is only operated in a sound condition and in working order;
- the instruction manual is in good condition and complete, and always available for reference at the place of installation of the Control Panel;
- the Control Panel is operated, maintained and repaired only by suitably qualified and authorized personnel.
- the personnel is instructed regularly about relevant occupational safety and environmental protection aspects, and is familiar with the operating manual and in particular the safety notes contained herein.
- none of the safety and warning notes attached to the Control Panel are removed, and all notes remain legible.

*National regulations depending on the machine type*

Depending on the type of machine and plant in which the Control Panel is used, national regulations governing the controllers of such machines will apply, and must be observed by the operator. These regulations cover, amongst other things, the intervals between inspections of the controller.

The operator must initiate such inspections in good time.

*Procedure in the event of a fault*

In the event of faults at the Control Panel, the list in the section [Troubleshooting](#) can be used to determine the measures to be taken.

## Operator requirements

*Read the operating instructions*

Anyone who uses the Control Panel must have read these operating instructions.

*Software knowledge*

Every user must be familiar with any of the functions of the software installed on the PC that he can reach.

# Product Description

## Appropriate Use

The CP70xx Control Panel is designed for industrial application in machine and plant engineering. An aluminum housing contains a TFT display, touch-screen/pad (optional), and a PC keyboard (optional). The panel is installed via the 4 mounting holes in the backplane or the mounting arm system adapter (optional).

*Do not use the Control Panel in areas of explosive hazard*

**The Control Panel must not be used where there is a risk of explosion.**

*Control Panel CP70xx connections*


## Connections



CP-Link

### Pin assignment

*CP-Link A Data*



BNC-connector

Pin	Signal	Pin	Signal
1	RXD	2	GND

*CP-Link B Data, Power supply*



BNC-connector

Pin	Signal	Pin	Signal
1	TXD, Power supply	2	GND

### Connector description

#### CP-Link connection

*CP-Link*

The CP-Link connection allows data transmission between Control Panel and CP-Link-Interface card of the Industrial-PC and providing the Control Panel with the supply voltage. Two coaxial cables are required, the cable length between Control Panel and Industrial-PC amounts to at most 100 m. The red point on the CP-Link card and the red marking at the coaxial cable or at the bend protection allow better orientation while connecting the system.

*Protective Earthing*

#### Protective Earthing

The low resistance protective earthing connection is established via the ground bolt, which is located at the rear of the housing.



## CP-Link cable sets

Coaxial cable	CP-Link cable with BNC-connectors
<b>C9900-K114</b>	- Length 3 m (cable type Belden H155, bend radius 35 mm)
<b>C9900-K115</b>	- Length 5 m (cable type Belden H155, bend radius 35 mm)
<b>C9900-K116</b>	- Length 10 m (cable type Belden H155, bend radius 35 mm)
<b>C9900-K117</b>	- Length 15 m (cable type Belden H155, bend radius 35 mm)
<b>C9900-K118</b>	- Length 20 m (cable type Belden H155, bend radius 35 mm)
<b>C9900-K119</b>	- Length 30 m (cable type Aircell7, bend radius 25 mm)
<b>C9900-K120</b>	- Length 35 m (cable type H2000FLEX, bend radius 50 mm)
<b>C9900-K121</b>	- Length 50 m (cable type H2000FLEX, bend radius 50 mm)
<b>C9900-K122</b>	- Length 65 m (cable type H2000FLEX, bend radius 50 mm)
<b>C9900-K123</b>	- Length 70 m (for easy installation at the PC and the mounting arm: 1 m Aircell7 + 61 m Cellflex + 8 m Aircell7)
<b>C9900-K124</b>	- Length 80 m (for easy installation at the PC and the mounting arm: 1 m Aircell7 + 71 m Cellflex + 8 m Aircell7)
<b>C9900-K125</b>	- Length 90 m (for easy installation at the PC and the mounting arm: 1 m Aircell7 + 81 m Cellflex + 8 m Aircell7)
<b>C9900-K126</b>	- Length 100 m (for easy installation at the PC and the mounting arm: 1 m Aircell7 + 91 m Cellflex + 8 m Aircell7)



**Note**

For the connection of one Control Panel to an Industrial-PC, one CP-Link cable set is required. Each set contains 2 cables.

# Installation Instructions

Please also refer to chapter [General Notes](#).

## Transport and Unpacking

The specified storage conditions must be observed (see chapter [Technical data](#)).

### Transport

Despite the robust design of the unit, the components are sensitive to strong vibrations and impacts. During transport, your Control Panel should therefore be protected from excessive mechanical stress. Therefore, please use the original packaging.



Danger of damage to the unit!

If the device is transported in cold weather or is exposed to extreme variations in temperature, make sure that moisture (condensation) does not form on or inside the device.

Prior to operation, the unit must be allowed to slowly adjust to room temperature. Should condensation occur, a delay time of approximately 12 hours must be allowed before the unit is switched on.

### Unpacking

Proceed as follows to unpack the unit:

1. Remove packaging.
2. Do not discard the original packaging. Keep it for future relocation.
3. Check the delivery for completeness by comparing it with your order.
4. Please keep the associated paperwork. It contains important information for handling the unit.
5. Check the contents for visible shipping damage.
6. If you notice any shipping damage or inconsistencies between the contents and your order, you should notify Beckhoff Service.




# Assembly

## Assembly dimensions

The illustration shows the measurements of the Control Panel.  
All dimensions are in mm.

### Control Panel CP70xx

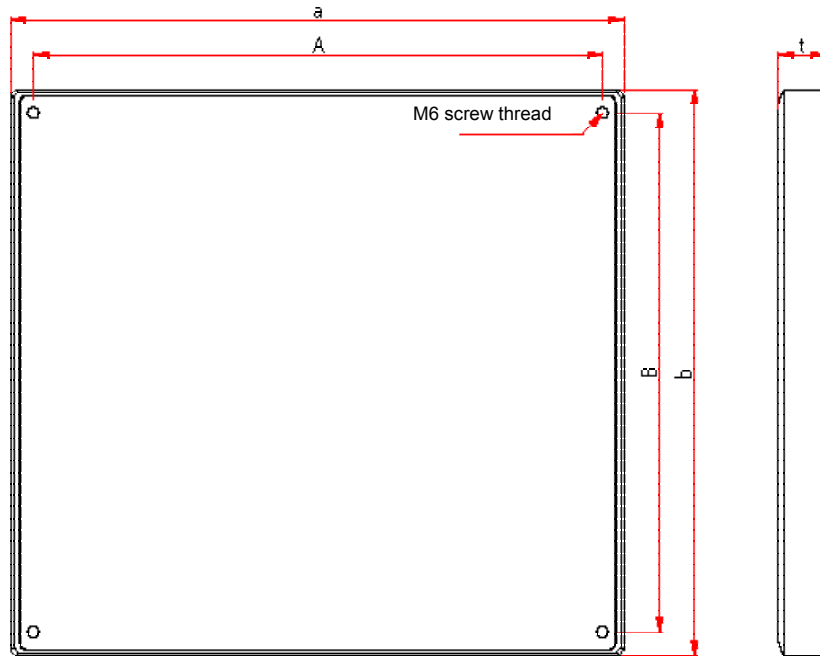

Dimensions		a	b	t	A	B
CP7009	6,5" Display	267,9	173	38	241,9	149
CP7000	10" Display	353,8	308,3	27,5	327,6	280,7
CP7001	12" Display	353,8	326,3	27,5	327,6	303,7
CP7002	15" Display	426	395	28,5	399,8	367,4

### Control Panel CP701x

Dimensions		a	b	t	A	B
CP7019	6,5" Display	267,9	213	38	241,9	189
CP7010	10" Display	353,8	308,3	27,5	327,6	280,7
CP7011	12" Display	353,8	326,3	27,5	327,6	303,7
CP7012	15" Display	426	395	28,5	399,8	367,4

### Control Panel CP702x

Dimensions		a	b	t	A	B
CP7029	6,5" Display	336	213	38	310	189
CP7020	10" Display	406	308,3	27,5	374,8	280,7
CP7021-0000/1	12" Display	406	308,3	27,5	374,8	280,7
CP7021-0002	12" Display	439,8	308,3	27,5	408,6	280,7
CP7022	15" Display	515	370,2	28,5	483,8	342,6

### Control Panel CP703x

Dimensions		a	b	t	A	B
CP7030	10" Display	403,2	368,2	27,5	372,15	340,6
CP7031-0000/1	12" Display	406	370,2	27,5	379,8	342,6
CP7031-0002	12" Display	426	370,2	27,5	399,8	342,6
CP7037	12" Display	426	370,2	27,5	399,8	342,6
CP7032	15" Display	483	410,2	28,5	458,8	387,6

## Connecting the Control Panel



**Danger**



**Warning**

The Control Panel must never be connected or disconnected in an area that is subject to explosion hazard! Risk of explosion!

The mains plug of the Industrial PCs must be disconnected!

Please read the documentation for the external devices prior to connecting them.

During thunderstorms, plug connector must neither be inserted nor removed.

When disconnecting a plug connector, always handle it at the plug. Do not pull the cable!

### Connecting cables

The connections are located at the rear of the Control Panel and are documented in the [Product Description](#) section.

When connecting cables to the Control Panel, please adhere to the following order:

- Switch off the Industrial PC
- Disconnect the Industrial PC from the power supply
- Connect all cables at the Control Panel and at the devices to be connected
- Ensure that all screw connections between plug connectors and sockets are tight!
- Reconnect all devices to the power supply.

### Protective Earthing

*Protective Earthing*

The low resistance protective earthing connection is established via the ground bolt, which is located at the rear of the housing.



# Operating Instructions

Please also refer to chapter [General Notes](#).

## Functional description

### Switch on

The Control Panel does not have its own mains power switch. As soon as the power supply is switched on the control panel is activated.

### Switching off

Control software, as typically applied in Control Panels, enables the assignment of different rights to all users. A user who is not entitled to shut down the software may not switch off the Control Panel as an attempt to shut it down when the software is running could result in the loss of software data on the Compact Flash memory card.

If the control panel is shut down while the software is writing a file onto the Compact Flash memory card, the file will be destroyed. Control software typically writes something to the CF memory card every few seconds, so that the probability of causing damage by switching off while the software is running is very high.

### Operation

The Control Panel's membrane keypad may only be actuated by fingertips.



### Note

Attempts to actuate it with other objects can easily result in the destruction of the device. Neither may the membrane keypad be operated with a touch screen pen.

The touch screen may only be actuated by finger tips or with the touch screen pen. The operator may wear gloves but there must be no hard particles such as metal shavings, glass splinters embedded in the glove.

## Keyboard codes

### Type-dependent number of keys

Depending on the precise type, the Control Panel can have fewer keys than those described here.

### Operation



The cursor is the blinking character that marks the point at which the next character entered will be displayed. The cursor is also known as the insertion point. The cursor keys each move the cursor one place in the associated direction.



The Home key moves the cursor to the beginning of the line, while the End key moves it to the end of the line.



The *Pg Up* key scrolls one page back, the *Pg Dn* key scrolls one page forward.



The Tab key takes the cursor to the next input field, while Shift and Tab moves to the previous input field.



The mouse cursor can be moved over the screen with the aid of the touch screen or of the touch pad (optional). The keys correspond to the left and right hand keys of a Microsoft mouse.



The *Del* key deletes the character to the right of the cursor.



The *Ins* key causes characters to the right of the cursor to be overwritten. The overwrite mode is cancelled by pressing the key again.



*Print-Screen* prints a hard copy of a text screen on the printer.



The Pause key stops the computer until another key is pressed (only under MS-DOS).



Your input is confirmed with the Enter key.



Backspace deletes the character to the left of the cursor.



If the Shift key is pressed at the same time as another key, then instead of the numbers you obtain the character printed above the number, and you obtain upper case letters instead of lower case letters.



Pressing the *Caps Lock* key once activates and locks the *Shift* key. Pressing the *Shift* key cancels this function.



Rather like the effect of the *Shift* key, *Ctrl* and *Alt* also change the meaning of another key that is pressed at the same time.



This key brings up the Start menu of the operating system in use (Windows 95, 98, ME, NT, 2000, XP).



Pressing this key opens the property sheet of the active (or marked) object.




The *Esc* key has the effect of closing dialog windows and of interrupting some of the computer's working operations.



All other keys bring the character printed on them onto the display at the position of the cursor.



The meaning of the function keys, *F1* to *F10*, is determined by the software and is displayed at the bottom edge of the display.



The function of the special keys above the display is also determined by the software. The function is displayed at the top edge of the display. The special keys each have an orange LED controlled by the software.

## Servicing and maintenance

Please also refer to the section [General Notes](#).

### Cleaning the Control Panel

*First switch the Industrial PC off*

Switch off the Industrial PC and all connected devices in order to prevent inadvertent operation of keys.

The front of the Control Panel can be cleaned with a soft, damp cleaning cloth. Do not use any aggressive cleaning materials, thinners, scouring material or hard objects that could cause scratches.

### Servicing

The Control Panel is maintenance-free.

### Replacing the fluorescent lamps in the display

Since fluorescent lamps represent a consumable item in a display, they must be replaced after a few years, depending on the number of operating hours.

The fluorescent lamps of the 6.5 inch, 12 inch and 15 inch displays can be replaced by a **technically competent person**.



Note

**Replacement of the fluorescent lamps may require partial disassembly of the display!**

Replacement for the 6.5 inch display

Press down the plastic clips below the supply cable of the lamps while you carefully pull out the fluorescent lamps in direction of the arrows.


After the exchange of the fluorescent lamps the installation takes place in reverse order.



Replacement for the 12 inch display

First release the screw (2) with a small Philips screwdriver, then tilt the fluorescent tubes with their brackets (1) carefully outwards.


After the exchange of the fluorescent lamps the installation takes place in reverse order.

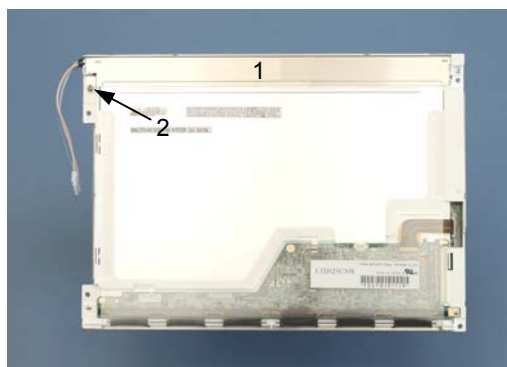

Replacement for the 15 inch display

First release the two screws (1) and (2) with a small Philips screwdriver, then carefully pull out the fluorescent lamps in direction of the arrows.

After the exchange of the fluorescent lamps the installation takes place in reverse order.

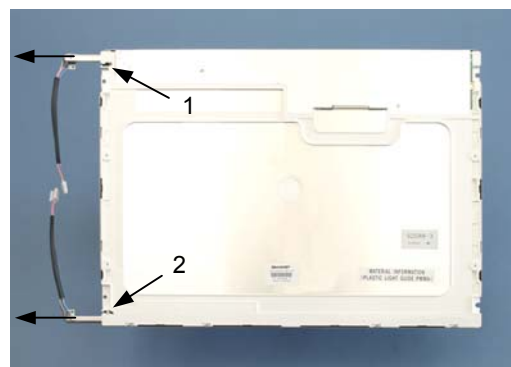

### Lamp sets

Order number	Background illumination unit for
C9900 - L360	6.5 inch TFT display NL6448BC20-08
C9900 - L364	12 inch TFT display LTD121C30S
C9900 - L366	15 inch TFT display LQ150X1LW71N

## Emergency procedures

In case of fire, the control panel should be extinguished with powder or nitrogen.

## Shutting down

### Disposal

The device must be fully dismantled in order to dispose of it. The housing can be sent for metal recycling.

Electronic parts such as lamps and circuit boards must be disposed of in accordance with national electronics scrap regulations.

*Dismantle the Control Panel*

*Observe national electronics scrap regulations*

# Troubleshooting

Please also refer to the section [General Notes](#).



**Note**

**Pixel errors in the TFT display are production-caused and represent no complaint-reason!**

## Fault correction

<b>Fault</b>	<b>Cause</b>	<b>Measures</b>
The Control Panel shows no function when the Industrial PC has been started	No power supply to Industrial PC  CP-Link-cable connected not or exchanged	Check power supply cable  1. Correctly connect CP-Link-cable: Put the plug with the red marking into the socket with the red point. 2. Call Beckhoff Service
The Industrial PC does not boot fully	Floppy disk in the drive  Hard disk damaged (e.g. by switching off while software running)  Setup settings are incorrect  Other cause	Remove floppy disk and press any key  1. Boot with boot diskette 2. Start SCANDISK  Check the setup settings  Call Beckhoff Service
Computer boots, software starts, but control does not operate correctly	The cause of the error is in the software or in parts of the equipment outside the control panel	Call the manufacturer of the machine or the software
Floppy disk access error	Faulty disk  Faulty disk drive	Check disk in another drive  Call Beckhoff Service
The control panel only exhibits partial function, or only some of the time - e.g., no or dark picture, although disk drive operates when switched on	Faulty fluorescent bulb in the display  Defective components in control panel	Replace fluorescent tube in the display in accordance with description  Call Beckhoff Service.

## Service and Support

Beckhoff and their partners around the world offer comprehensive service and support, making available fast and competent assistance with all questions related to Beckhoff products and system solutions.

### Beckhoff's branch offices and representatives

Please contact your Beckhoff branch office or representative for [local support and service](#) on Beckhoff products!

The addresses of Beckhoff's branch offices and representatives round the world can be found on her internet pages:

<http://www.beckhoff.com>

You will also find further [documentation](#) for Beckhoff components there.

### Beckhoff headquarters

Beckhoff Automation GmbH  
Eiserstraße 5  
D-33415 Verl  
Germany

Phone: +49(0)5246/963-0  
Fax: +49(0)5246/963-198  
e-mail: [info@beckhoff.com](mailto:info@beckhoff.com)

### Beckhoff Support

Support offers you comprehensive technical assistance, helping you not only with the application of individual Beckhoff products, but also with other, wide-ranging services:

- world-wide support
- design, programming and commissioning of complex automation systems
- and extensive training program for Beckhoff system components

Hotline: +49(0)5246/963-157  
Fax: +49(0)5246/963-9157  
e-mail: [support@beckhoff.com](mailto:support@beckhoff.com)

### Beckhoff Service

The Beckhoff Service Center supports you in all matters of after-sales service:

- on-site service
- repair service
- spare parts service
- hotline service

Hotline: +49(0)5246/963-460  
Fax: +49(0)5246/963-479  
e-mail: [service@beckhoff.com](mailto:service@beckhoff.com)

Quote the project number

If servicing is required, please quote the **project number** of your Industrial PC.



# Appendix

## Technical data

<i>Dimensions</i>	<b>Dimensions (W x H x D):</b> see section <a href="#">Assembly dimensions</a>
<i>Operation in areas that are subject to explosion hazard</i>	<b>The Control Panel must not be used where there is a risk of explosion.</b>
<i>Environmental conditions</i>	<p><b>The following conditions must be observed during operation:</b></p> <p><b>Ambient temperature:</b> 0 to 55°C</p> <p><b>Atmospheric humidity:</b> Maximum 95%, non-condensing</p>
<i>Shock resistance</i>	<p><b>Sinusoidal vibration:</b> (EN 60068-2-6)</p> <p>10 to 58 Hz: 0.035 mm 58 to 500 Hz: 0.5 G (~ 5 m/ s<sup>2</sup>)</p> <p><b>Impact:</b> (EN 60068-2-27/ 29)</p> <p>5 G (~ 50 m/ s<sup>2</sup>), duration: 30 ms</p>
<i>Protection class</i>	<p><b>Control Panel:</b> IP65</p> <p><b>Connector plug:</b> IP54</p>
<i>Power supply</i>	<b>Supply voltage:</b> The Control Panel is supplied with via the CP-Link-connection
<i>EMC compatibility</i>	<p><b>Resistance to interference:</b> according to EN 61000-6-2</p> <p><b>Emission of interference:</b> according to EN 61000-6-4</p>
<i>Transport and storage</i>	The same values for atmospheric humidity and shock resistance are to be observed during transport and storage as in operation. Suitable packaging of the Control Panel can improve the resistance to impact during transport. The ambient temperature during storage and transport must be between -20°C and +65°C.



Note

**Pixel errors in the TFT display are production-caused and represent no complaint-reason!**

## Approvals

### FCC: Federal Communications Commission Radio Frequency Interference Statement

*FCC Approval for USA*

This equipment has been tested and found to comply with the limits for a Class A digital device, pursuant to Part 15 of the FCC Rules. These limits are designed to provide reasonable protection against harmful interference when the equipment is operated in a commercial environment. This equipment generates, uses, and can radiate radio frequency energy and, if not installed and used in accordance with the instruction manual, may cause harmful interference to radio communications. Operation of this equipment in a residential area is likely to cause harmful interference in which case the user will be required to correct the interference at his own expense.

### FCC: Canadian Notice

*FCC Approval for Canada*

This equipment does not exceed the Class A limits for radiated emissions as described in the Radio Interference Regulations of the Canadian Department of Communications.